
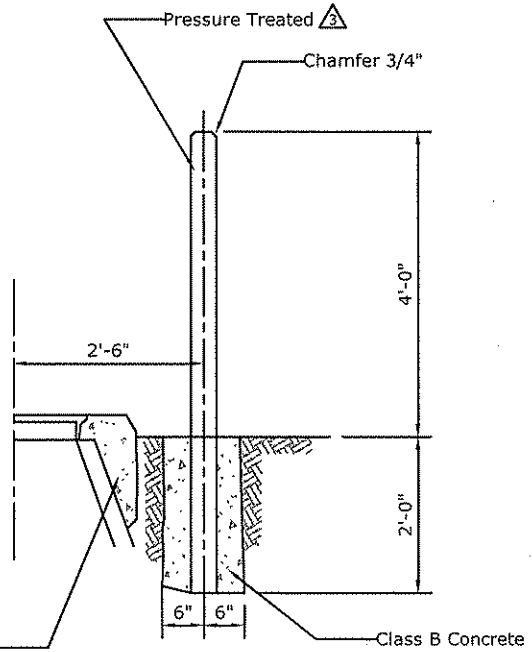


Scale: 1"=30'

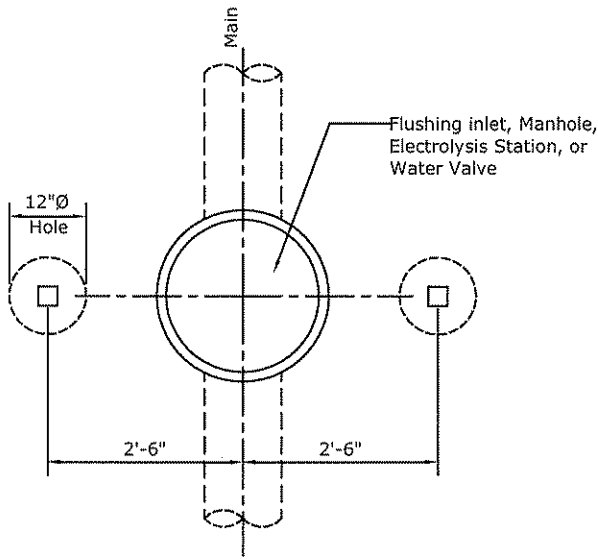

For Collar Details:
 Manhole - Std. Dwg. 230
 Water Valve - Std. Dwg. 702
 Flushing Inlet - Std. Dwg. 602
 Electrolysis Sta. - Std. Dwg. 750

NOTES:

1. Marker Posts shall be used in unimproved easements and Rights of Way to locate manholes, water, valves, flushing inlets, blowoffs, electrolysis stations, and other facilities as required by the City Engineer.
2. Posts shall be 4"x4"x6'-0" preservative treated or redwood, and painted with two(2) coats of outside white paint.
3. Legend to be labeled on posts in 3" black letters are as follows:
 - a. On sanitary sewers: C. of M.
 - b. On storm sewers: C. of M.
 - c. On water lines: On side facing valve, show size of valve
On Opposite side, show C. of M.
 - d. On electrolysis stations: T.S. on test stations
A.S. on anode stations
4. Only one marker post shall be installed per electrolysis station.

CITY OF MILPITAS, ENGINEERING DIVISION			STANDARD DRAWING NO. 204
REVISION	DATE	MARKER POSTS IN EASEMENTS	DATE : 6/15/10
1	1976		APPROVED BY: PUBLIC WORKS DIRECTOR / CITY ENGINEER RCE No. 40283
2	2001		
3	2010		
3			SHEET 1 OF 1