


Scale: 1"=30'

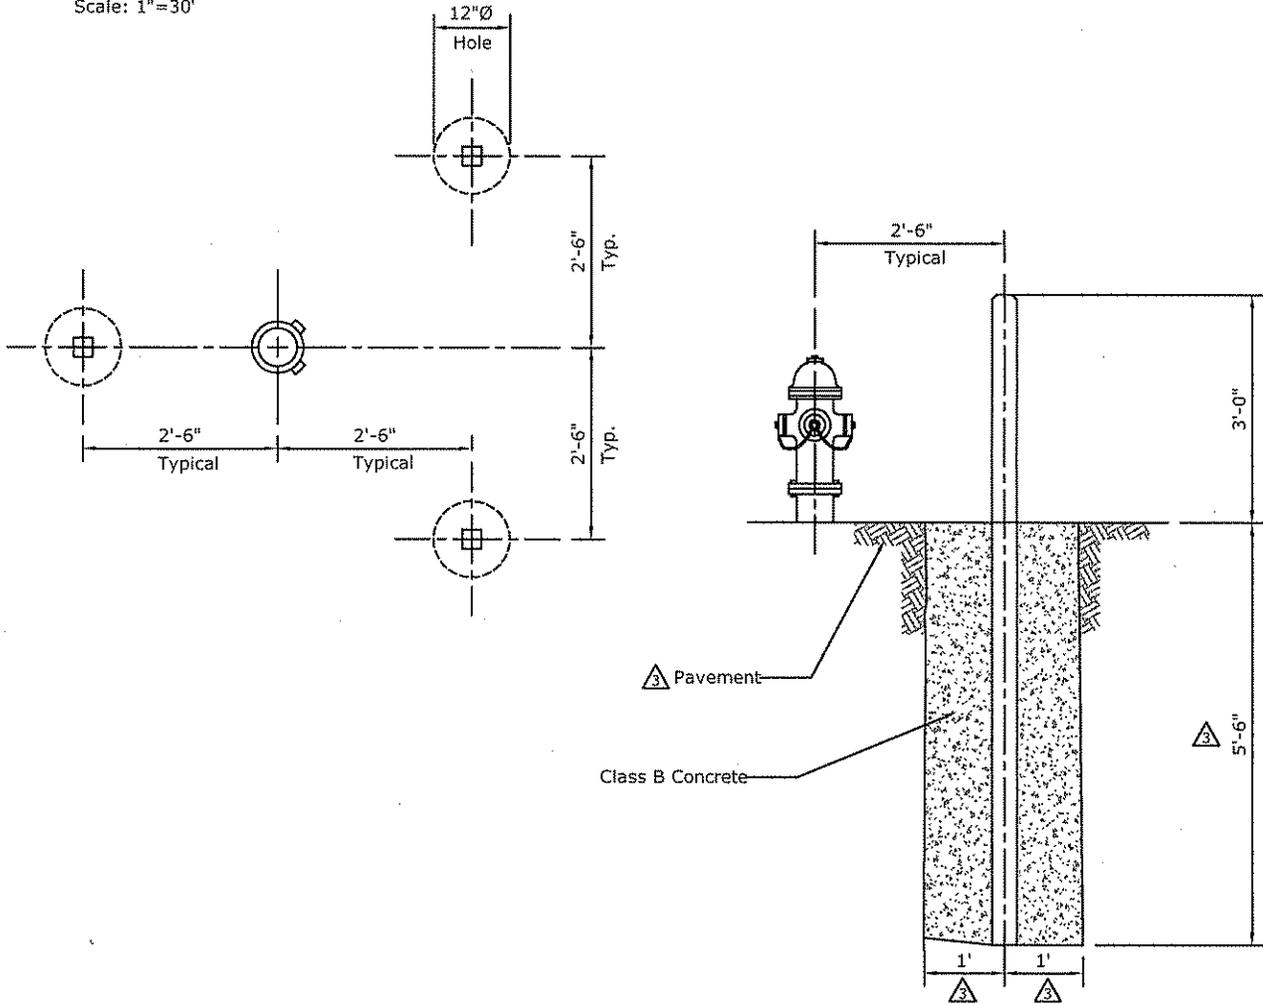

NOTES:

1. Posts shall be 4" galvanized steel pipe, ASA schedule 40, filled with concrete.
2. Posts shall be given 2 coats of exterior yellow paint. Paint shall be heavy-duty industrial metal enamel.
3. Location and number of posts shall be as shown on plans approved by the City Engineer.
4. Posts shall be used for protection of fire hydrants, above ground piping exposed to traffic and underground vaults which are not designed for traffic loads. Posts will not be required where curbs or parking barriers are effectively located to protect the facility.

CITY OF MILPITAS, ENGINEERING DIVISION

STANDARD DRAWING
NO. 206

TRAFFIC BARRIER POSTS

DATE : 6/15/10

REVISION	DATE
1	1967
2	2001
3	2010



APPROVED BY:

PUBLIC WORKS DIRECTOR / CITY ENGINEER RCE No. 40283

SHEET 1 OF 1