



SINGLE PARKING STALL

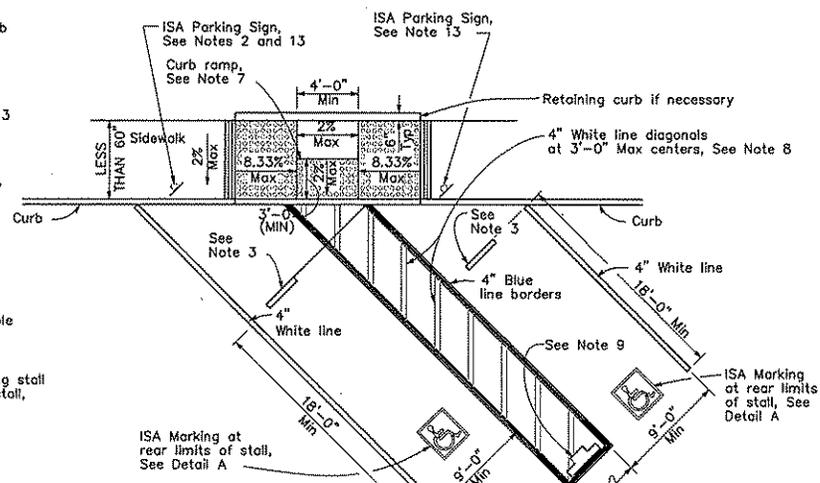


DIAGONAL DOUBLE PARKING STALLS

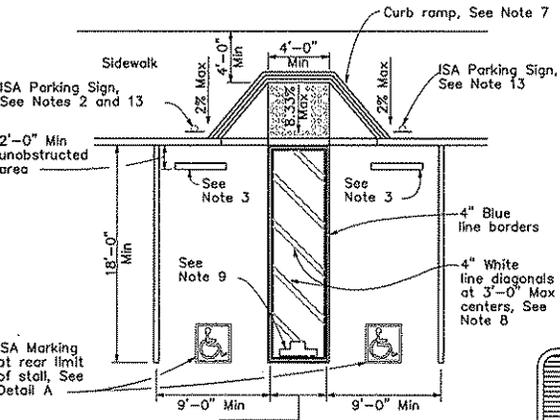

DOUBLE PARKING STALL

TABLE A

Total Number of Parking Spaces or Stalls	Minimum Number of Disabled Accessible Parking Spaces or Stalls
1-25	1
26-50	2
51-75	3
76-100	4
101-150	5
151-200	6
201-300	7
301-400	8
401-500	9
501-1000	2 percent of total
Greater than 1001	20 plus 1 for each 100 or fraction thereof over 1001



DETAIL A
ISA MARKING
See Revised Std Plan RSP A24C



SIGN R99 (CA)




SIGN R99C (CA)
See Note 6



PLAQUE R99B (CA)

SIGN R99 (CA) with PLAQUE R99B (CA)
See Note 6

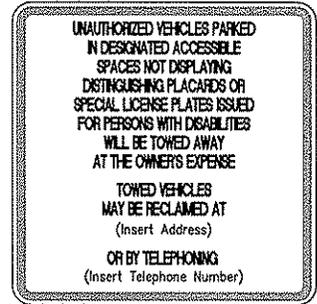

SIGN R100B (CA)
See Note 10



SIGN R7-8b
See Notes 2 and 6

ISA = International Symbol of Accessibility

OFF-STREET PARKING SIGNS
(Parking lot or garage)
See Note 6


CITY OF MILPITAS, ENGINEERING DIVISION

STANDARD DRAWING NO. 423

ACCESSIBLE PARKING OFF-STREET

DATE : 6/15/10

REVISION	DATE
1	1997
2	2001
3	2010

APPROVED BY: 
PUBLIC WORKS DIRECTOR / CITY ENGINEER PCE No. 40283

SHEET 1 OF 2

NOTES:

1. Accessible parking spaces serving a particular building shall be located on the shortest accessible route of travel from adjacent parking to an accessible entrance. In parking facilities that do not serve a particular building, accessible parking shall be located on the shortest accessible route of travel to an accessible pedestrian entrance of the parking facility.
2. One in every eight accessible off-street parking stalls, but not less than one, shall be served by an accessible aisle of 8'-0" minimum width and shall be signed van accessible. The R7-8b sign shall be mounted below the R99B (CA) plaque or the R99C (CA) sign.
3. In each parking stall, a curb or bumper shall be provided and located to prevent encroachment of vehicles over the required width of walkways. Parking stalls shall be so located that persons with disabilities are not compelled to wheel or walk behind parked cars other than their own.
4. Surface slopes of accessible off-street parking stalls shall be the minimum possible and shall not exceed 2 percent in any direction.
5. Table A shall be used to determine the required number of accessible parking stalls in each parking lot or garage.
6. Where Plaque R99B (CA), Sign R99C (CA) or Sign R7-8b are installed, the bottom of the sign or plaque panel shall be a minimum of 7'-0" above the surrounding surface.
7. Curb ramps shall conform to the details shown on City's Standard Drawing Nos. 419 and 420.
8. Blue paint, instead of white may be used for marking accessibility aisles in areas where snow may cause white markings to not be visible.
9. The words "NO PARKING", shall be painted in white letters no less than 1'-0" high and located so that it is visible to traffic enforcement officials. See Revised Standard Plan RSP A90B for details of the "NO PARKING" pavement marking.
10. A R100B (CA) sign shall be posted in a conspicuous place at each entrance to off-street parking facilities or immediately adjacent to and visible from each stall. The sign shall include the address where the towed vehicle may be reclaimed and the telephone number of the local traffic law enforcement agency.
11. Where a single (non-van) accessible parking space is provided, the loading and unloading access aisle shall be on the passenger side of the vehicle as the vehicle is going forward into the parking space.
12. Where a van accessible parking space is provided, the loading and unloading access aisle shall be 8'-0" wide minimum, and shall be on the passenger side of the vehicle as the vehicle is going forward into the parking space.
13. Accessible Parking Only Sign shall be Sign R99C (CA) or Sign R99 (CA) with Plaque R99B (CA).
14. Glue-on or bolt down tactile warning plates shall not be used.

CITY OF MILPITAS, ENGINEERING DIVISION

STANDARD DRAWING

ACCESSIBLE PARKING
OFF-STREET

NO. 423

REVISION

DATE

1

1997

2

2001

3

2010

DATE : 6/15/10

3

APPROVED BY:

PUBLIC WORKS DIRECTOR / CITY ENGINEER RCE No. 40283

SHEET 2 OF 2