



CURB & WALK SEPARATED

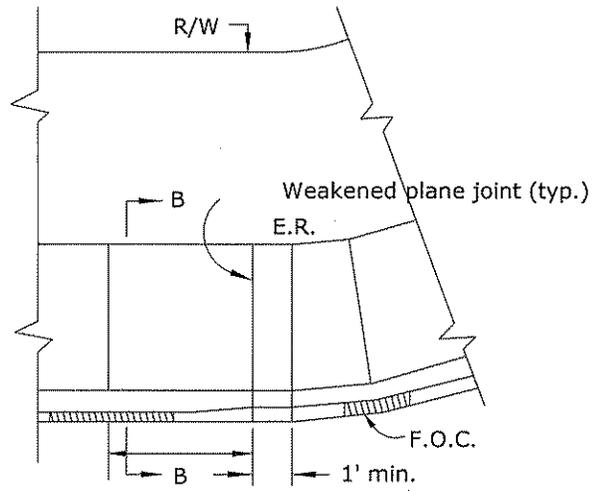


CURB & WALK CONTIGUOUS

PLAN

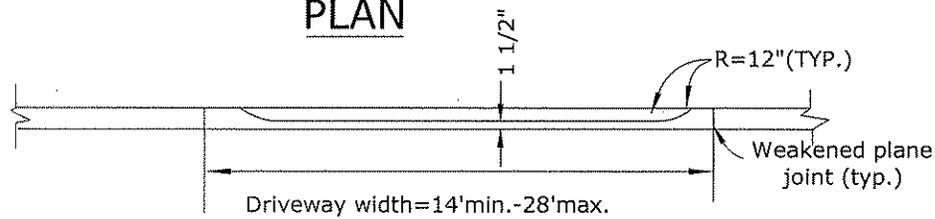

ELEVATION

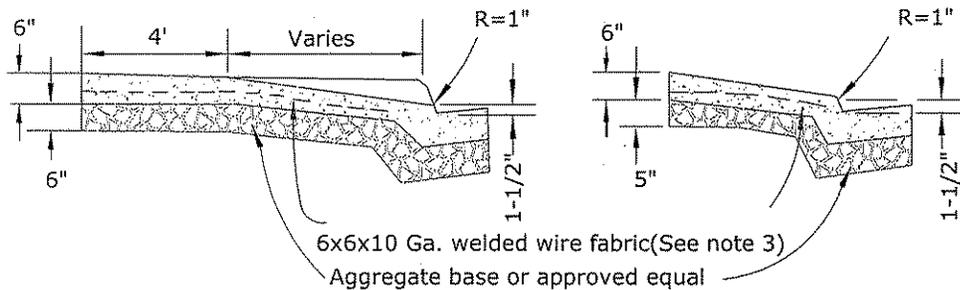

SECTION A-A

SECTION B-B

NOTES:

1. Score lines shall be 1/4 inch deep and 48 inches apart in sidewalk areas.
2. Use Portland Cement Concrete containing not less than 564 lbs. of Type I or I/II Portland Cement per cubic yard with a compressive strength of not less than 3000 psi. at 28 days, with a medium broom finish min.
3. Welded wire fabric shall be used when driveway serves more than one residential units.
4. Driveway locations shall be approved by the City Engineer.
5. The minimum spacing between driveways serving the same parcel shall be 18 feet.
6. Limits of driveway width shall be as shown unless otherwise approved by the City Engineer.
7. Access to developed site shall be maintained.

NOT TO SCALE

CITY OF MILPITAS, ENGINEERING DIVISION

STANDARD DRAWING

RESIDENTIAL DRIVEWAY

NO. 430

REVISION

DATE

1

1975

2

2001

3

2010

3

APPROVED BY:

PUBLIC WORKS DIRECTOR / CITY ENGINEER RCE No. 40283

DATE : 6/15/10

SHEET 1 OF 1